

 <p>2820 S. English Station Road - Louisville, KY 40299          Tel: (502) 357-0132 Fax (502) 267-8379</p>	<p><b>Date:</b> 16-Aug-18      <b>TEST NO.</b> 18-430-1</p> <p style="text-align: center;"><b>ASHRAE Standard 52.2-2017</b>  <b>TEST REPORT</b>  <b>Initial Efficiency / Resistance</b></p>
--	---

**Filter Description**

Manufacturer	Viskon-Aire Corp
Filter Model	Series 55 Panel
Part Number	880-000
Generic Filter Type	Pad -Tack Poly
Nominal Dimensions (H x W x D)	24" x 24" x2"
Pocket / Pleat Quantity	N/A
Media Type	Tack Poly
Est. Gross Media Area	4 Ft <sup>2</sup>
Adhesive Type	PBT-32



**Test Conditions**

Loading Dust Type	NA	Test Air Temp (degrees F.)	73
Barometric Pressure (In. Hg.)	29.34	Relative Humidity (%)	47

**Test Results**



<b>Airflow Rate (CFM)</b>	<b>400</b>
<b>Nominal Face Velocity (fpm)</b>	<b>100</b>
<b>Initial Resistance (in WG)</b>	<b>0.06</b>
<b>E1 (%) Initial Efficiency 0.30 - 1.0 um</b>	<b>1</b>
<b>E2 (%) Initial Efficiency 1.0 - 3.0 um</b>	<b>4</b>
<b>E3 (%) Initial Efficiency 3.0 - 10.0 um</b>	<b>53</b>
<b>Estimated * Minimum Efficiency Reporting Value (MERV)</b>	<b>MERV 7 @ 400 CFM</b>
<i>* If initial data is minimum</i>	

**Comments** Tested For:      Visikon-Aire Corp

Test Performed by: CR      Approved By:  Page 1 of 3

Important Note: Please be advised that the ASHRAE committee SSPC 52.2, in March 2016, has published "addendum e" relative to the 52.2-2012 test protocol. This addendum restricts the use of the acronym "MERV" as only applicable to a test report that has been completed using the "entire procedure prescribed by the standard". This report is a modified version of the procedure and therefore, subject to that ruling. In the best interest of our customers, Blue Heaven Technologies has elected to delay this action until further assessment can be made at committee level. Where applicable, the qualified use of the term "MERV" will continue to be part of our reported data.

Test No. 18-430-1  
Date: 16-Aug-18

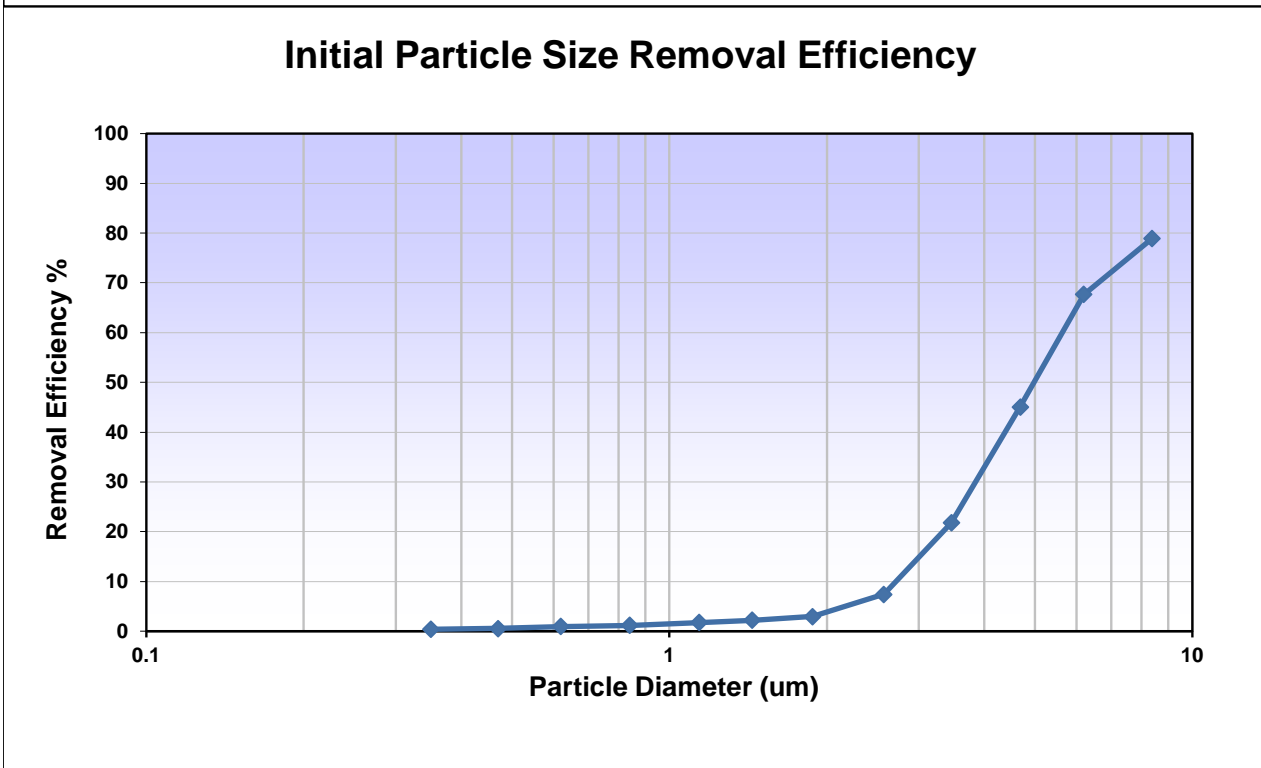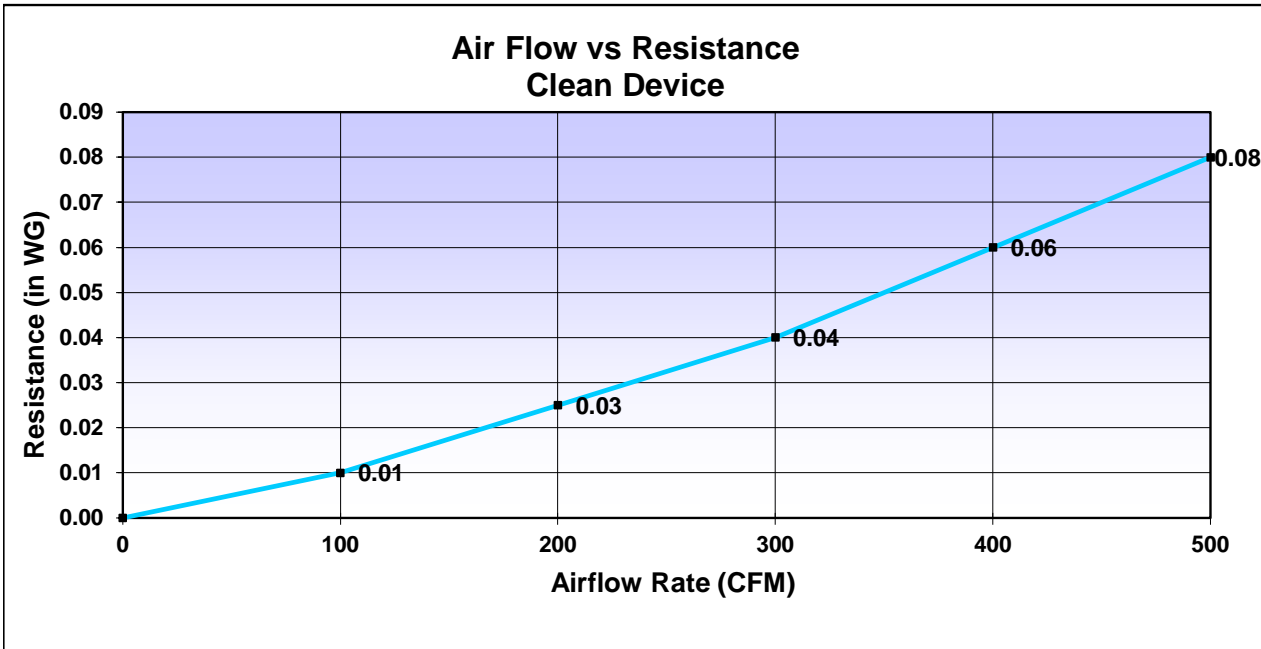

Test No. 18-430-1  
Date: 16-Aug-18

### Data - Initial Resistance

Airflow (CFM)	Resistance (in WG)
0	0.00
100	0.01
200	0.03
300	0.04
400	0.06
500	0.08

### Data - Particle Removal Efficiency

Particle Size Range (um)	Geometric Mean Diam (um)	Initial Particle Removal Efficiency (%)
0.30 - 0.40	0.35	0.4
0.40 - 0.55	0.47	0.6
0.55 - 0.70	0.62	0.9
0.70 - 1.00	0.84	1.2
1.00 - 1.30	1.14	1.7
1.30 - 1.60	1.44	2.2
1.60 - 2.20	1.88	2.9
2.20 - 3.00	2.57	7.4
3.00 - 4.00	3.46	21.8
4.00 - 5.50	4.69	45.0
5.50 - 7.00	6.20	67.7
7.00 - 10.00	8.37	78.9